


External manual bypass/ATS - PDU - 10Amp

EMBP-PDU-10A

This versatile PDU-style unit functions as both an external manual bypass and an automatic transfer switch, compatible with 1-2.2kVA UPS systems. During normal operation (UPS mode), the ATS seamlessly switches to mains power if the UPS fails or power is unavailable, ensuring uninterrupted power supply. Ideal for flexible and reliable power management.



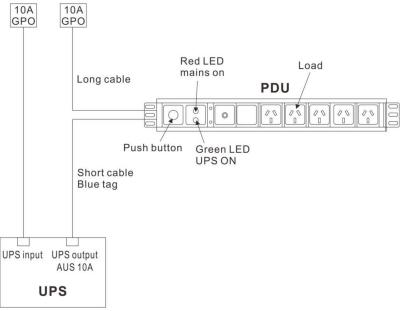

LED ILLUMINATED	FUNCTION ON PDU LOAD OUTPUTS
Red	Mains power
Red and Green	UPS power

FEATURES

- ✓ Rack / Wall / UPS Mount
- ✓ Used on 1-2.2kVA (Ensure UPS has correct plug types)


INSTALLATION

(UPS and GPO input to run off the same circuit)

- 1. Plug long cable into wall GPO
- 2. Plug UPS input into wall GPO
- Plug short cable (blue tag) into back of UPS (UPS output)
- 4. Switch both GPOs on, Red light will illuminate
- 5. Switch UPS on
- 6. Push Button Green LED will illuminate

DISCONNECTING UPS

- 1. Push button so only red LED is illuminated
- 2. Switch UPS off and remove

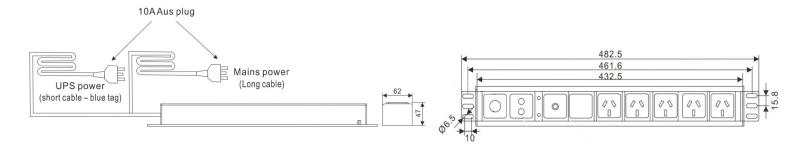




External manual bypass/ATS - PDU - 15Amp

EMBP-PDU-15A

Designed for 3kVA UPS systems, this robust PDU-style unit serves as both an external manual bypass and an automatic transfer switch. During normal operation (UPS mode), the ATS automatically switches to mains power if the UPS fails or power is unavailable, ensuring continuous power delivery. Perfect for managing high-capacity setups with ease and reliability.



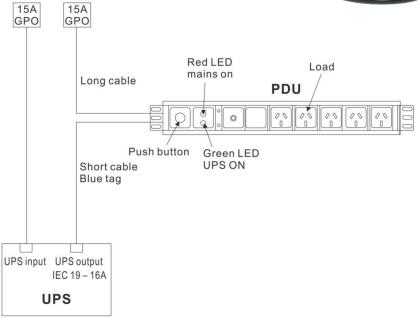

LED ILLUMINATED	FUNCTION ON PDU LOAD OUTPUTS
Red	Mains power
Red and Green	UPS power

FEATURES

- ✓ Rack / Wall / UPS Mount
- ✓ Used on 3kVA (Ensure UPS has correct plug types)
- ✓ 15Amp in and out

INSTALLATION

(UPS and GPO input to run off the same circuit)

- 1. Plug long cable into wall GPO
- 2. Plug UPS input into wall 15A GPO
- Plug short cable (blue tag) into back of UPS (UPS output)
- 4. Switch both GPOs on, Red light will illuminate
- 5. Switch UPS on
- 6. Push Button Green LED will illuminate

DISCONNECTING UPS

- . Push button so only red LED is illuminated
- 2. Switch UPS off and remove

